

Cambridgeport

SUBMITTAL


Part Number
2000104

SUBMITTED TO _____
COMPANY _____
JOB NAME _____
EQUIPMENT _____
SIGNATURE _____
DATE _____


© 2007 COX ENGINEERING DBA CAMBRIDGEPORT AIR SYSTEMS.
THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROPRIETARY TO
COX ENGINEERING COMPANY DBA CAMBRIDGEPORT AIR SYSTEMS.
THIS DOCUMENT OR THE INFORMATION CONTAINED IN WHOLE OR IN PART
MAY NOT BE ISSUED TO ANOTHER PARTY WITHOUT WRITTEN CONSENT AND
AUTHORIZATION FROM CAMBRIDGEPORT.

SUBMITTAL

REVISIONS			
ZONE	REV.	DESCRIPTION	DATE
APPROVED			

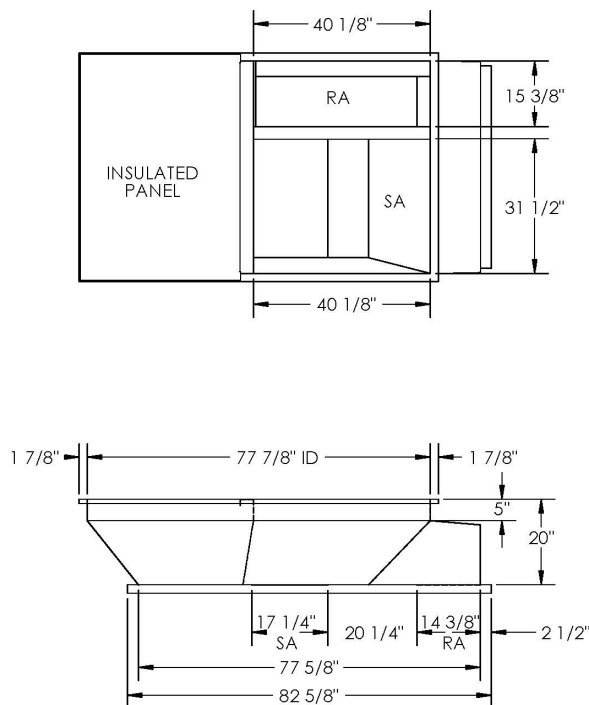

MATERIAL: 18GA.(0.0516) 192.5 LBS.

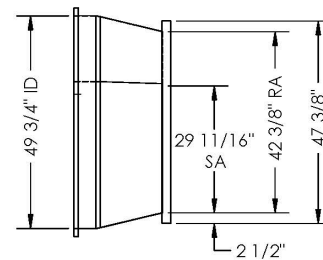

FEATURES:

1. ONE PIECE WELDED CONSTRUCTION
2. CURB ADAPTER MADE OF HEAVY GAUGE GALVANIZED STEEL.
3. ALL WELDS ARE COATED WITH A GALVANIZED COMPOUND.
4. GASKETING IS PROVIDED FOR UNIT TO CURB ADAPTER SEALING.
5. CURB ADAPTER IS FULLY INSULATED.
6. SUPPLY TRANSITION AND RETURN PLENUM INCLUDED.

Approved By: _____

Date: _____

Cambridgeport		NORTH 8 Farnham Drive Salisbury Industrial Park Salisbury MA 01962	1-800-648-2872 1-877-648-2872	SOUTH 2529 Lamar Ave. Lamar Industrial Park Memphis TN 38119
HVAC Accessories & Engineered Systems				
UNLESS OTHERWISE SPECIFIED:	CUSTOMER:	DRAWN:	DESCRIPTION:	
TOLERANCES:	CUSTOMER:	DATE:	01/22/17	
DECIMALS = + .063 FRACTIONS = + 1/16 ANGLES = ± 1°	CUSTOMER:	DATE:	01/22/17	
MATERIAL CONDITIONS:	CUSTOMER:	DATE:	01/22/17	
REMOVE ALL BURRS & SHARP EDGES ALL DIMENSIONS ARE O.D.	CUSTOMER:	DATE:	01/22/17	
SUBMITTAL NO. 2000104		PART NO. 2000104		REV.
DETAIL OF 2000104		SHEET 1 OF 1		2000104
ASS'Y, ADAPTER				

FEATURES

- ONE PIECE WELDED CONSTRUCTION
- FACTORY INSTALLED SUPPLY TRANSITIONS
- FULLY INSULATED
- DESIGNED FOR EVEN WEIGHT DISTRIBUTION
- FABRICATED OF HEAVY GAUGE G90 GALVANIZED STEEL
- ALL WELDS SPRAYED WITH GALVANIZING COMPOUND
- GASKET PROVIDED FOR UNIT TO ADAPTER SEALING

CAMBRIDGEPORT STRONGLY RECOMMENDS CONFIRMING THE DIMENSIONS ON THIS SUBMITTAL

CURB ADAPTERS ARE BASED ON UNIT MANUFACTURERS STANDARD CURB DIMENSIONS.
CAMBRIDGEPORT CANNOT BE RESPONSIBLE FOR ANY DEVIATIONS FROM FACTORY DIMENSIONS OR INCORRECT MODEL NUMBERS.